


**D.I./PVC GRAVITY
SEWER PIPE TRENCH**

(STANDARD LAYING CONDITION "TYPE 5")

N.T.S.

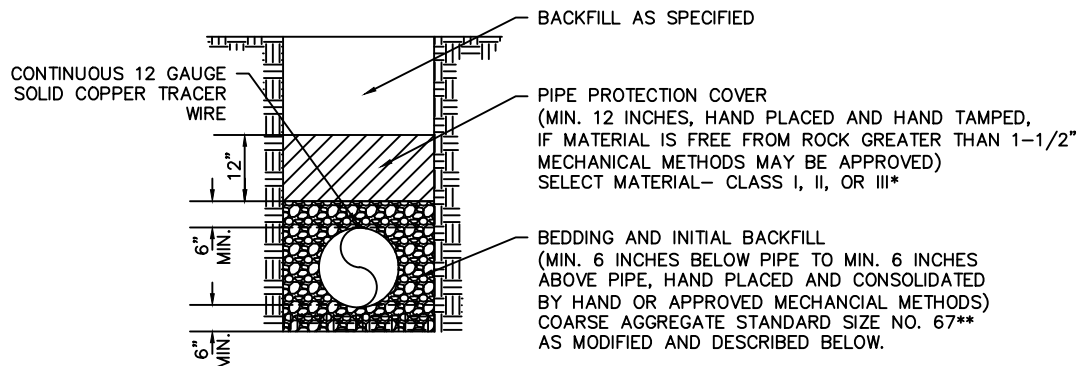

**PE/PVC PRESSURE
SEWER PIPE TRENCH**

(STANDARD LAYING CONDITION "TYPE 5")

N.T.S.

S-19

NOTE: SEE STANDARD DETAIL M-1,
"TRACER WIRE CONNECTION PORT" FOR
TRACER WIRE PORT SPACING

* CLASS I, II, AND III AS DEFINED IN
ASTM D2487 AND THE PIPE BACKFILL
MATERIAL AND AGGREGATE BASE
COURSE FILL SECTION OF THE
SPECIFICATIONS

** STANDARD SIZE NO. 67 AS DEFINED
IN ASTM D448, MAXIMUM EMBEDMENT
PARTICLE SIZE SHALL NOT EXCEED
3/4 IN. FOR ANGULAR ROCK, OR
1-1/2 IN. FOR ROUNDED ROCK. FOR
PE PIPE UP TO 4 IN. MAX PARTICLE
SIZE SHALL NOT EXCEED 1/2 IN.

SPRINGDALE
WATER UTILITIES

STANDARD DETAILS
FOR
WATER AND SEWER CONSTRUCTION