


PLAN VIEW

NOTES:

1. ALL HYDRANTS SHALL BE SET PLUMB WITH THE PUMPER NOZZLE FACING THE STREET OR AS DIRECTED BY S.W.U.
2. HYDRANTS SHALL BE LOCATED IN STREET RIGHT-OF-WAY OR DEDICATED UTILITY EASEMENT, AND A MINIMUM OF 4' BEHIND ANY CURB AND GUTTER OR SIDEWALK.
3. IF REQUIRED, GUARD POSTS SHALL BE SET PLUMB WITH SPACING AND ORIENTATION AS INDICATED IN THE PLAN VIEW OR AS OTHERWISE SHOWN ON THE PLANS.
4. ALL HYDRANTS SHALL BE PAINTED USING RUSTOLEUM V2100 SILVER ALUMINUM ENAMEL AEROSOL, OR APPROVED EQUAL. PRIOR TO FINAL ACCEPTANCE COORDINATE WITH SWU TO DETERMINE THE FLOW RATE AND PAINT BONNET AND CAP ACCORDING TO SECTION T18 OF THE STANDARD SPECIFICATIONS. ALL GUARD POSTS SHALL BE PAINTED SAFETY YELLOW.

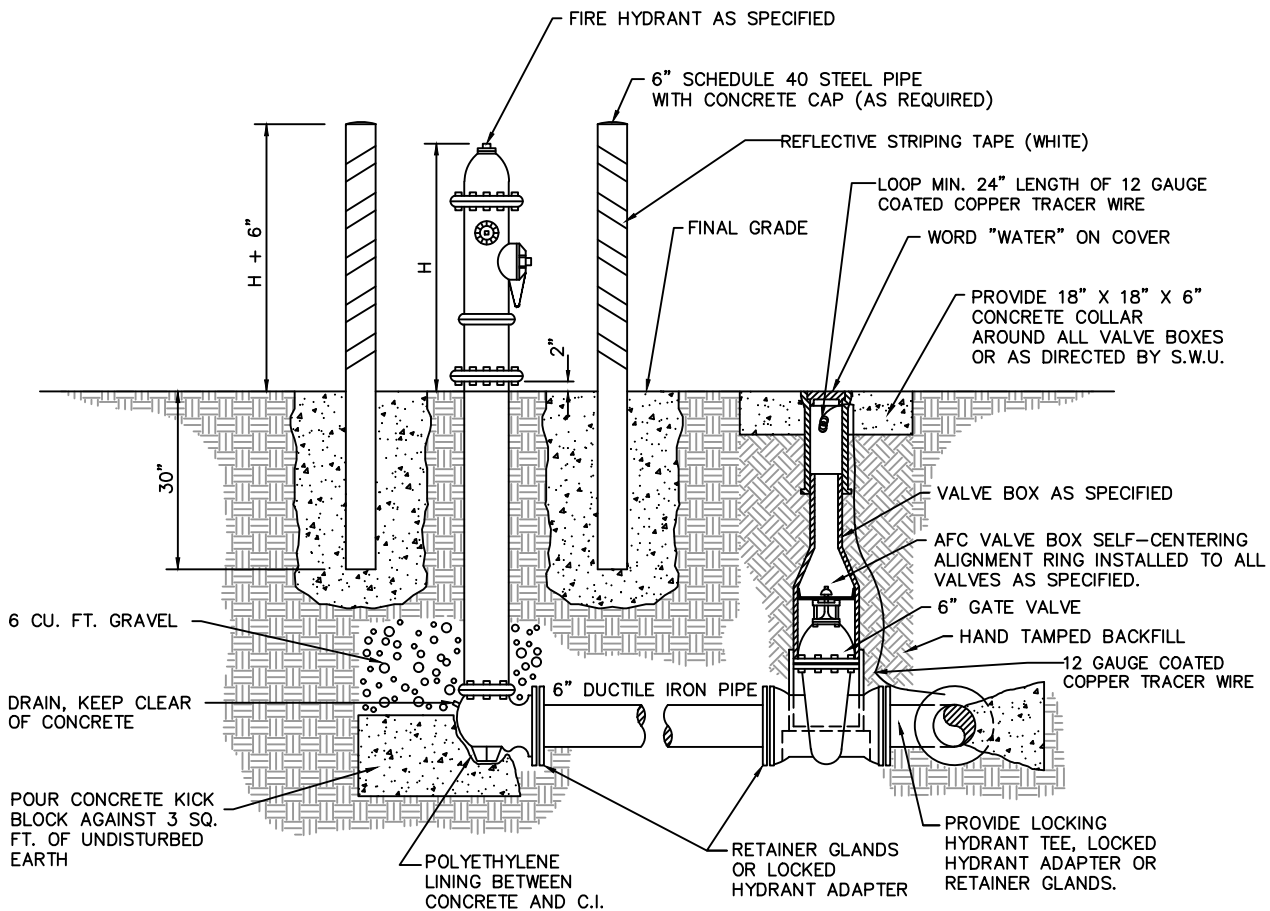

FIRE HYDRANT WITH GUARD POSTS

(GUARD POST ONLY AS REQUIRED)

N.T.S.
S-2



526 OAK AVENUE • P.O. BOX 769 • SPRINGDALE, ARKANSAS • 72765-0769 • (479) 751-5751

STANDARD DETAILS
FOR
WATER AND SEWER CONSTRUCTION

DRAWN BY: KMI/JNK

DRAWING NO: S-2

DATE: AUGUST 2025